


1. Occ. Name: PLEASANT VALLEY SCHOOL
 2. Address: 17625 SE FOSTER RD
 3. Occ Type: (219) NONRESIDENTIAL SCHOOL
 4. Cross St: RICHEY RD



6. Pg **1** of **2**

8. Map # **M25**

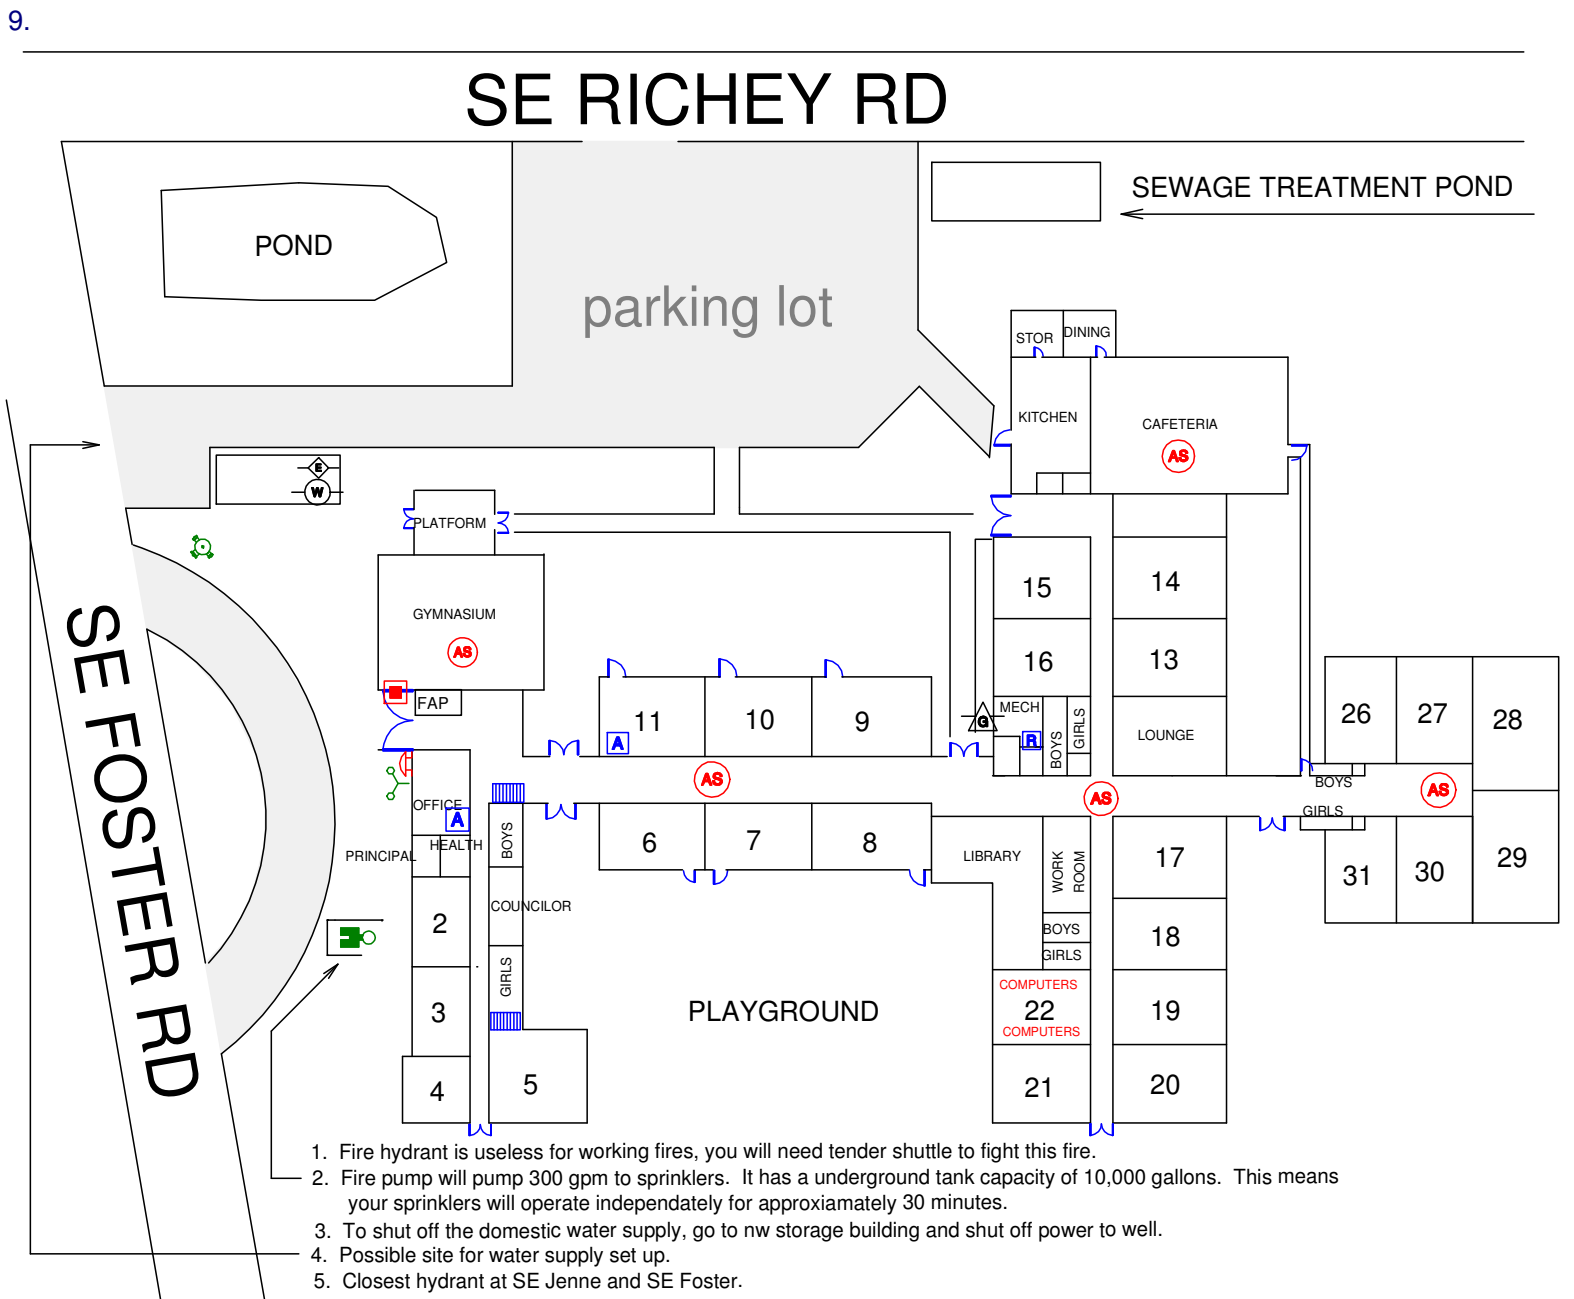

1. Fire hydrant is useless for working fires, you will need tender shuttle to fight this fire.
2. Fire pump will pump 300 gpm to sprinklers. It has a underground tank capacity of 10,000 gallons. This means your sprinklers will operate independatly for approxiamately 30 minutes.
3. To shut off the domestic water supply, go to nw storage building and shut off power to well.
4. Possible site for water supply set up.
5. Closest hydrant at SE Jenne and SE Foster.

10. Sprinkler: FDC Location
SW CORNER IN YARD

11. Haz Materials
GENERAL SCHOOL

12. Standpipe: FDC Location
NONE

13. Best Access
RICHEY RD

14. Bldg Ht. **2** Stories **20** Ft. 15. Bldg Area **64,680** Ft. \times Ft.

16. Roof Construction Light Heavy Truss **X** Unprotected Steel
 Heavy Truss Heavy Timber Protected Steel Concrete